

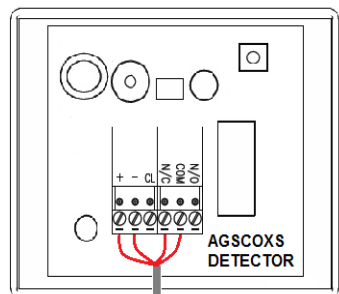


120VAC line voltage supply to AGS Merlin Panel  
12-14AWG 3/4" COND.

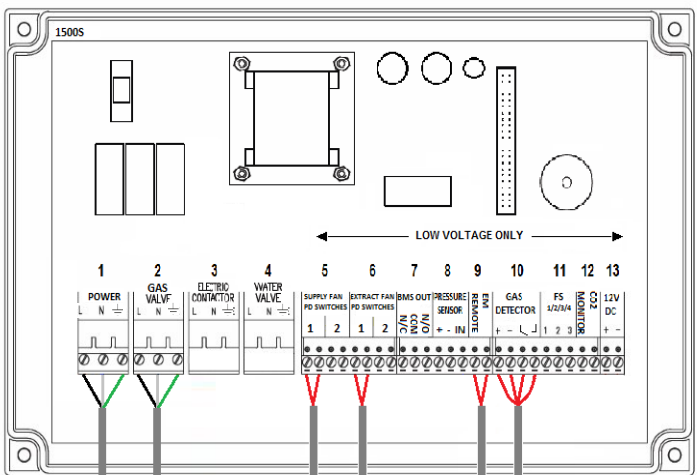


+ & - 24VDC  
Normally Closed  
18-22 AWG Dry Contact

120VAC from AGS Merlin Panel  
12-14AWG 3/4" COND.



Normally Closed  
18-22 AWG Dry Contact



Normally Closed  
18-22 AWG Dry Contact

- HOT
- NEUTRAL
- GROUND
- LOW VOLTAGE



Client	
Job Title	
Drawing Title	

**Notes**  
All discrepancies between information shown on the drawing and information in the specification to be referred to American Gas Safety prior to proceeding.

Copyright in all documents and drawings prepared by American Gas Safety and any work executed from these documents shall, unless otherwise agreed, remain the property of American Gas Safety.

Amendments		
Scale	Date	Drawn
N.T.S.		BT
Dwg. No.	Rev.	
1500S & AGSCOXS	1	