


NORMALLY OPEN CONTACT FROM  
AGSMGFS MANUAL FAN SWITCH  
(2X)

NORMALLY CLOSED CONTACT FROM  
AGSESOTW E-STOP (2X)

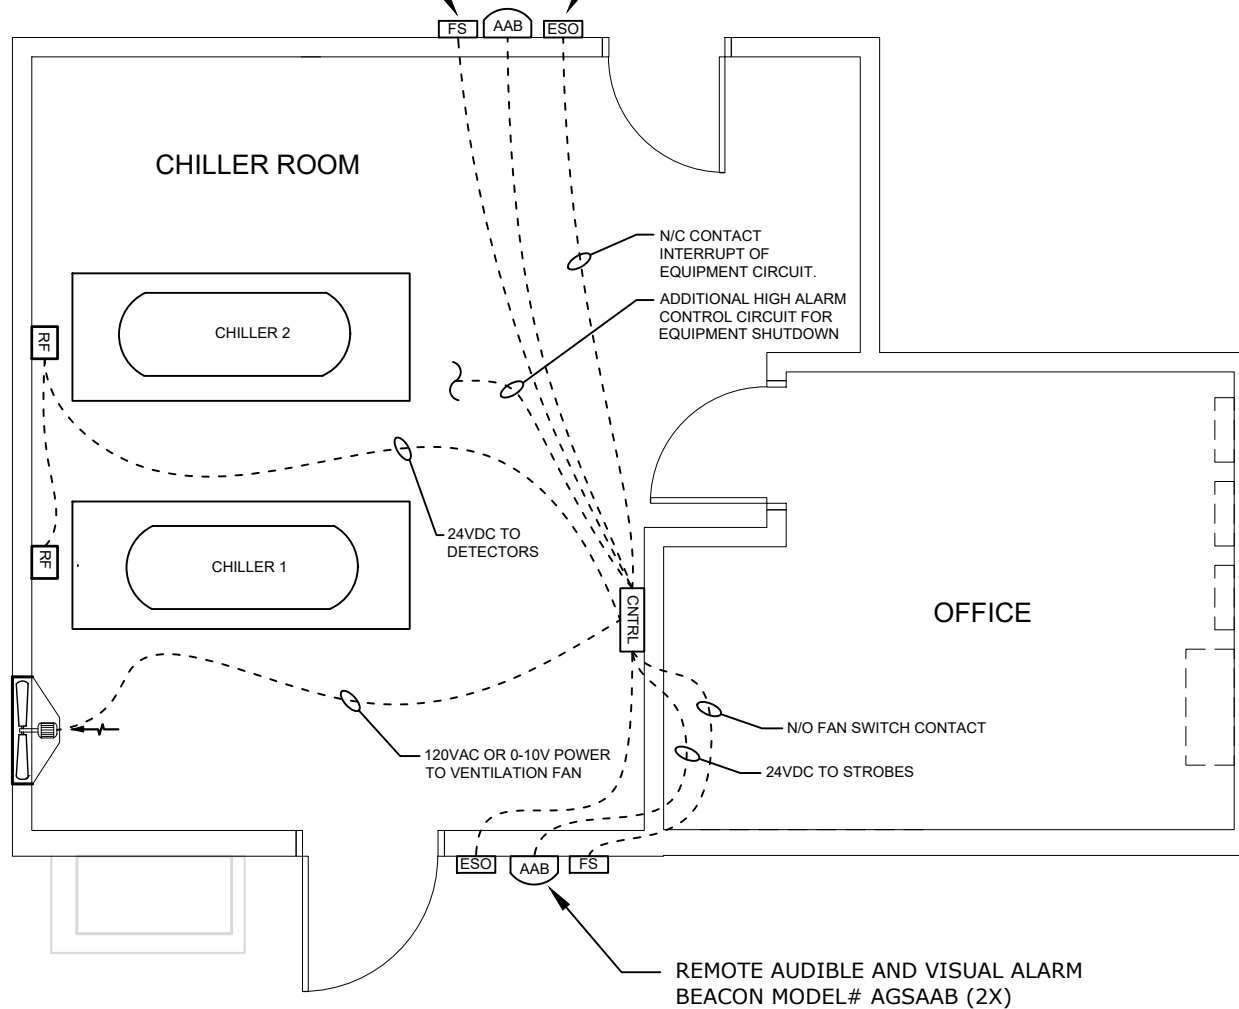

CHILLER ROOM

CHILLER 2

CHILLER 1

OFFICE

N/C CONTACT  
INTERRUPT OF  
EQUIPMENT CIRCUIT.

ADDITIONAL HIGH ALARM  
CONTROL CIRCUIT FOR  
EQUIPMENT SHUTDOWN

24VDC TO  
DETECTORS

120VAC OR 0-10V POWER  
TO VENTILATION FAN

N/O FAN SWITCH CONTACT

24VDC TO STROBES

REMOTE AUDIBLE AND VISUAL ALARM  
BEACON MODEL# AGSAAB (2X)